


**UNICON**

## SMALL AIR COOLED CONDENSERS

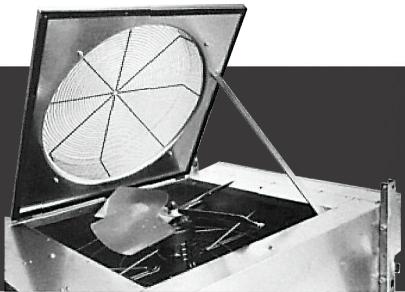

## Efficient and Reliable

Kramer's Remote Air Cooled Condensers' innovative design provides a wide array of solutions focusing on performance, energy efficiency, reduced sound output and other requirements to meet the needs of the grocery, supermarket, industrial cooling and commercial warehousing industries.

### Standard Features

- Direct drive motor arrangement
- Vertical air flow
- 1075 or 850 RPM motors
- Motors with inherent thermal overload protection
- Copper tube, aluminum fin coils
- Leak tested at 450 PSIG
- Vinyl coated heavy gauge steel fan guards
- Heavy gauge galvanized steel construction for superior corrosion resistance
- Internal divider isolates fan cells (2 fan models)

### Options

- Fan cycling head pressure control (2 fan models)
- Variable speed fan control (header end fan only)
- Head pressure control (loose)
- Sub-cooling circuit
- Horizontal air flow
- Multi-circuited coils
- Wide selection of fin coatings and materials

MODEL NUMBER NOMENCLATURE														
I	D	S	007	D	A	2	B	1	2	A	1	A	1	A
K	I	II	III	IV	V	VI	VII	VIII	IX	X	XI	XII	XIII	XIII
I Model Series K - Kramer	VI Motor/Fan Type A - 1075 RPM, 0.33 HP, Metal Blade	IX Coil Material and Coating Options* 1 - Aluminum fins 2 - Copper fins 3 - Al + AST coating 6 - Al + Heresite	XII Circuit Splitting Options 1 - Full 2 - 50/50 X - Other											
II Unit Type D - Condenser	C - 850 RPM, 0.25 HP, Metal Blade	X Housing Material and Coatings* 2 - Galvanized 7 - Stainless Steel 316L	XIII Vintage Code - Single Alphanumeric Character A - Initial Release											
III Series S - Single fan wide	H^ - 1075 RPM, 0.5 HP Totally Enclosed, Metal Blade	XI Unit Design Configuration A - Vertical Fan Discharge, Standard Legs												
IV Capacity - 3 Number Characters	VII Length in Fans - 1 or 2	E - Vertical Fan Discharge, 30" Legs												
V Voltage Code A - 115/1/60 D - 208-230/1/60 E - 208-230/3/60 F - 460/1/60 G - 460/3/60	VIII Coil Density A - 8 FPI B - 10 FPI C - 12 FPI D - 14 FPI	N - Horizontal Fan Discharge, Standard Legs												
Codes D, E, F, & G can be used w/50 or 60 Hz power														

<sup>^</sup> CODE H can be used with **E or G voltage only**.

### Table of Contents

	Page(s)
Features and Options Chart .....	3
Condenser Selection Procedure .....	4-5
Head Pressure Control Option .....	6
Performance and Specifications	
Physical Dimensions and Drawings .....	6
1140 RPM Models .....	7
850 RPM Models .....	8

## Features and Options

DESCRIPTION			
<b>GENERAL CONSTRUCTION</b>	Vertical Air Discharge Configuration	STANDARD	
	Horizontal Air Discharge Configuration*	OPTIONAL	
	Galvanized Steel Casing	STANDARD	
	Stainless Steel 316L Housing	OPTIONAL	
	Protective Coating for External Casing	OPTIONAL	
	Heavy Gauge Galvanized Steel Legs	Vertical Discharge - Leg Length 15" Vertical Discharge - Leg Length 30"	STANDARD OPTIONAL
<b>CONDENSER COIL AND CIRCUITING</b>	Aluminum Tube Sheets	STANDARD	
	Copper Tubes Mechanically Expanded into Aluminum Fins	STANDARD	
	Leak tested at 450 PSIG	STANDARD	
	Coil Circuiting:	Single Circuit 50/50 Multi-Circuiting Sub-Cooling Circuits	STANDARD OPTIONAL OPTIONAL OPTIONAL
	Fin Spacing:	10 Fins per inch 8, 12 or 14 Fins Per Inch	STANDARD OPTIONAL
	Fin Materials:	Aluminum Fins Copper Fins	STANDARD OPTIONAL
<b>FIN MATERIALS, SPACING AND COATINGS</b>	Fin Coatings:	None ElectroFin® or Heresite	STANDARD OPTIONAL
	Rod Mounted Frame - Motor Mount	STANDARD	
	Fully Baffled Fan Modules	STANDARD	
<b>FAN/ MOTOR</b>	Motor Type:	Open Type Enclosed	STANDARD OPTIONAL
	Mounting Location:	Opposite Header End Header End	STANDARD OPTIONAL
<b>ELECTRICAL PANEL</b>	Temp. or Press. Fan Cycling (2 fan models only)	OPTIONAL	
	Variable Speed Header End Fan Control - Pressure Controlled	OPTIONAL	
<b>REFRIGERANT SPECIALTIES</b>	Flooded-Condenser Control Valve System (Loose)	OPTIONAL	
<b>SHIPPING</b>	Vertical Air Discharge Models - Legs Disassembled - Unit in Carton or Crate	STANDARD	
	Horizontal Discharge Models* - Legs Disassembled - Unit in Carton or Crate	OPTIONAL	

\* Horizontal discharge orientation is available using standard leg arrangement.

Control Panel Orientation differs between horizontal and vertical air flow.

## Condenser Selection

Air-cooled condenser capacity ratings are based on the total heat rejection of the refrigeration system. Total heat of rejection is the sum of the net refrigeration effect and heat of compression added to the refrigerant in the compressor.

The heat of compression varies with the compressor design, so the compressor manufacturer's information should be used whenever possible. If the compressor manufacturer's heat of compression information is not available, Tables 1 and 2 (page 5) may be used to determine the heat of compression.

The following formulas may be used to calculate the total heat rejection (THR) for systems that fall outside the normal limits of single stage compressor applications, such as compound or cascade systems.

Suction cooled hermetic compressors:

$$\text{THR} = \text{Compressor Capacity (BTUH)} + (3,413 \times \text{KW})$$

Open Compressors

$$\text{THR} = \text{Compressor Capacity (BTUH)} + (2,545 \times \text{BHP})$$

### ELEVATION CORRECTION

Elevation above sea level has an effect on the performance of air cooled condensers. Divide the required capacity by the Elevation Correction Factor in the table on page 5 to correct the requirement to Sea Level Conditions. The proper condenser can then be selected from the appropriate table on Pages 7 or 8.

### SINGLE CIRCUIT CONDENSERS

All units are available for single circuit applications.

### SELECTION EXAMPLE

**Given:**

Ambient Air Temperature = 95° F

Maximum Condensing Temperature = 110° F

Evaporator Temperature = 20° F

Refrigerant = R-404A

Compressor Capacity = 50,000 BTU

Compressor Type = Suction Cooled Semi-Hermetic

**Solution:**

Multiply the compressor capacity by the heat of compression factor to calculate the required total heat of rejection (THR). Table 1 shows that for 110°F condensing temperature and 20° F evaporator temperature, the heat of compression factor is 1.33. The required total heat rejection (THR) is:

$$50,000 \times 1.33 = 66,500 \text{ BTUH THR}$$

Divide the THR by the design condensing temperature of 15°F TD. (TD = Condensing Temperature - Ambient Temperature)

$$66,500 \div 15 = 4,433 \text{ BTUH per } 1^\circ\text{F TD}$$

Convert BTUH to MBH.

$$4,433 \text{ BTUH} \div 1,000 = 4.43 \text{ MBH per } 1^\circ\text{F TD}$$

The correct selection of a single fan width unit with 1140 RPM fan motors (page 7) is a model KDS007\*A2B12A1A with a capacity of 4.6 MBH @ 14FPI.

Since the unit selection will almost never have the exact required capacity, the actual TD will vary slightly from the design TD. The actual TD can be calculated using the following formula:

$$\text{Actual TD} = \frac{\text{Design THR}}{\text{Actual Condenser THR}} \times \text{Design TD}$$

For this example the actual TD would be:

$$\text{Actual TD} = \frac{4.43}{4.6} \times 15 = 14.4^\circ\text{F TD}$$

**Table 1: Heat of Compression Factors****Suction Cooled Compressors**

Evap Temp °F	Condensing Temperature °F								
	90	95	100	105	110	115	120	125	130
-40	1.66	1.70	1.73	1.76	1.80	1.90	2.00	†	†
-35	1.61	1.64	1.68	1.70	1.74	1.82	1.90	†	†
-30	1.57	1.60	1.62	1.65	1.68	1.74	1.80	†	†
-25	1.53	1.56	1.58	1.60	1.63	1.67	1.72	†	†
-20	1.49	1.51	1.53	1.55	1.58	1.61	1.65	†	†
-15	1.46	1.48	1.50	1.51	1.54	1.57	1.61	†	†
-10	1.42	1.44	1.46	1.48	1.50	1.53	1.57	1.60	1.64
-5	1.39	1.41	1.43	1.45	1.47	1.50	1.53	1.56	1.60
0	1.36	1.38	1.40	1.42	1.44	1.47	1.50	1.53	1.56
+5	1.33	1.35	1.37	1.39	1.41	1.43	1.46	1.49	1.52
+10	1.31	1.32	1.34	1.36	1.38	1.40	1.43	1.46	1.49
+15	1.28	1.30	1.32	1.33	1.35	1.37	1.40	1.43	1.46
+20	1.26	1.27	1.29	1.31	1.33	1.35	1.37	1.40	1.43
+25	1.24	1.25	1.27	1.29	1.31	1.33	1.35	1.37	1.40
+30	1.22	1.23	1.25	1.26	1.28	1.30	1.32	1.34	1.37
+35	1.20	1.21	1.23	1.25	1.26	1.27	1.29	1.31	1.34
+40	1.18	1.19	1.21	1.23	1.24	1.25	1.27	1.29	1.31
+45	1.16	1.17	1.19	1.21	1.22	1.23	1.25	1.26	1.28
+50	1.14	1.15	1.17	1.19	1.20	1.22	1.23	1.24	1.26

A. † Beyond the normal limits for single stage compressor application.

**Table 2: Heat of Compression Factors****Open Compressors**

Evap Temp °F	Condensing Temperature °F								
	90	95	100	105	110	115	120	125	130
-30	1.37	1.39	1.42	1.44	1.47	†	†	†	†
-20	1.33	1.35	1.37	1.39	1.42	1.44	1.47	†	†
-10	1.28	1.30	1.32	1.34	1.37	1.39	1.42	1.44	1.47
0	1.24	1.26	1.28	1.30	1.32	1.34	1.37	1.39	1.41
+10	1.21	1.23	1.24	1.26	1.28	1.30	1.32	1.34	1.36
+20	1.17	1.18	1.20	1.22	1.24	1.26	1.28	1.30	1.32
+30	1.14	1.15	1.17	1.18	1.20	1.22	1.24	1.25	1.27
+40	1.12	1.14	1.15	1.16	1.17	1.18	1.20	1.21	1.23
+50	1.09	1.11	1.12	1.13	1.14	1.16	1.17	1.19	1.20

A. † Beyond the normal limits for single stage compressor application.

**Table 3: Elevation Correction Factors**

Elevation (ft)	1,000	2,000	3,000	4,000	5,000	6,000	8,000	10,000	12,000	14,000	16,000
Correction Factor	0.94	0.93	0.90	0.88	0.86	0.83	0.79	0.75	0.71	0.66	0.62

## Head Pressure Control Options

### FLOODED CONDENSER

The Flooded Condenser Head Pressure Control Option maintains adequate condensing pressure while operating in low ambient temperatures. By flooding the condenser with liquid refrigerant, the amount of coil surface available for condensing is reduced. The resulting reduction in capacity ensures proper operation of the thermal expansion valve.

This option requires a modulating three-way valve, dependent on refrigerant discharge pressure, be placed at the condenser outlet. A fall in ambient temperature causes a corresponding fall in discharge pressure. The valve modulates allowing discharge gas to flow to the receiver, creating a higher pressure at the condenser outlet. This higher pressure reduces the flow out of the condenser, causing liquid refrigerant to back up in the coil. Flooding the condenser reduces the available condensing surface and raises the condensing pressure so that adequate high-side pressure is maintained.


A larger receiver and additional refrigerant are required for systems with flooded condenser control. The receiver can be conveniently installed directly under the condenser in most applications. However, if the system will be operational in ambient temperatures below 55° F, the receiver should be located in a warm environment or heated. In this situation, a check valve must be installed in the line between the receiver and condenser valve. This prevents refrigerant migration from the receiver to the condenser.

The amount of additional refrigerant charge is based on the lowest expected winter operating temperature and the design TD. In addition to the condenser charge, the operating charges of the evaporator, receiver and refrigerant lines must be added to determine the total system refrigerant charge. The pump-down capacity (80% of full capacity) of the receiver must be at least equal to the total system charge.




## Physical Data

Model Number	Drawing	A	B	C	D	E	F
KDS001*A1	KDS001*C1	1	12-1/2	28	25-9/16	13-3/4	26-5/8
KDS002*A1	KDS002*C1	1	12-1/2	28	25-9/16	13-3/4	26-5/8
KDS003*A1	KDS003*C1	1	14-3/8	33	30-9/16	15-5/8	31-5/8
KDS005*A1	KDS004*C1	1	14-3/8	33	30-9/16	15-5/8	31-5/8
KDS007*A2	KDS006*C2	2	14-3/8	66	30-9/16	15-5/8	64-5/8
KDS009*A2	KDS008*C2	2	14-3/8	66	30-9/16	15-5/8	64-5/8
KDS011*A2	KDS009*C2	2	14-3/8	66	30-9/16	15-5/8	64-5/8

DRAWING - 1 FAN

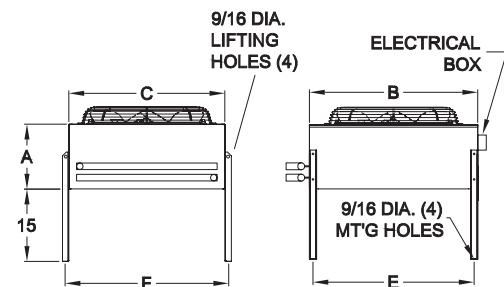

DRAWING - 2 FAN

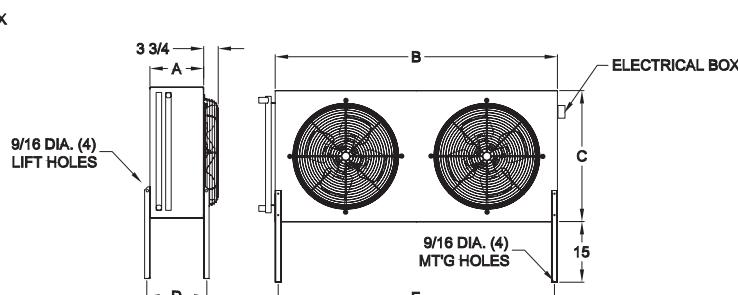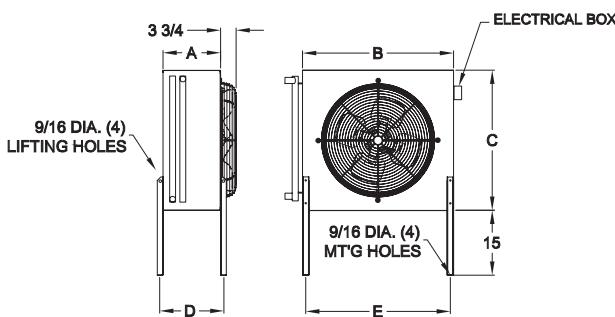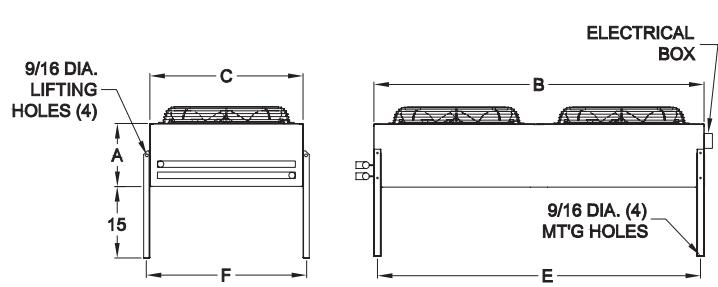

Note: All dimensions are in inches.

## Performance Data - 1075 RPM Fan Motors

THR MBH 1°F TD - R407A

Model Number	Fins Per Inch			
	8	10	12	14
KDS001*A1B12A1A	0.67	0.77	0.82	0.95
KDS002*A1B12A1A	1.16	1.26	1.38	1.48
KDS003*A1B12A1A	1.52	1.72	1.89	2.04
KDS005*A1B12A1A	2.18	2.43	2.61	2.75
KDS007*A2B12A1A	3.25	3.69	4.05	4.37
KDS009*A2B12A1A	4.47	4.98	5.34	5.64
KDS011*A2B12A1A	5.37	5.85	6.16	6.52

THR MBH 1°F TD - R404A &amp; R507

Fins Per Inch			
8	10	12	14
0.73	0.84	0.90	1.04
1.17	1.33	1.45	1.57
1.60	1.81	1.99	2.15
2.23	2.48	2.68	2.81
3.42	3.89	4.27	4.60
4.56	5.06	5.45	5.76
5.31	5.79	6.10	6.45

\* Each asterisk represents a variable character based upon voltage and vintage ordered. See page 2 for complete nomenclature.

For R-22 capacity, multiply R404A unit capacity by 1.02

For R-407C capacity, multiply R407A capacity by .98

For R-134a capacity multiply R-404A unit capacity by .97

For R-410A capacity, multiply R404A capacity by 1.08

### Notes:

- R-407A ratings are based on Mean Condensing Temperature which is the average of the Dew Point and Bubble Point temperatures corresponding to the refrigerant temperature at the condenser inlet.

## Specifications - 1075 RPM Fan Motors

Model Number	Fans				Maximum Circuit Quantity	Connection (Inches) <sup>^</sup>	Connection Quantity	Net Weight (Lbs.)	Unit kW
	Quantity	Diameter	CFM	dBA <sup>†</sup>					
KDS001*A1B12A1A	1	18	3,020	47.0	5	7/8	2	80	0.28
KDS002*A1B12A1A	1	18	2,840	47.0	10	7/8	2	86	0.28
KDS003*A1B12A1A	1	22	4,450	57.0	12	7/8	2	107	0.47
KDS005*A1B12A1A	1	22	3,900	57.0	18	7/8	2	116	0.47
KDS007*A2B12A1A	2	22	8,640	60.0	18	1-1/8	2	164	0.94
KDS009*A2B12A1A	2	22	7,780	60.0	27	1-1/8	2	179	0.94
KDS011*A2B12A1A	2	22	7,080	60.0	36	1-1/8	2	195	0.94

Model Number	208-230/1/60			208-230/3/60			460/1/60			460/3/60			575/1/60		
	FLA	MCA	MOPD	FLA	MCA	MOPD	FLA	MCA	MOPD	FLA	MCA	MOPD	FLA	MCA	MOPD
KDS001*A1B12A1A	3.2	15.0	15	1.8	15.0	15	1.3	15.0	15	0.9	15.0	15	1.0	15.0	15
KDS002*A1B12A1A	3.2	15.0	15	1.8	15.0	15	1.3	15.0	15	0.9	15.0	15	1.0	15.0	15
KDS003*A1B12A1A	3.2	15.0	15	1.8	15.0	15	1.3	15.0	15	0.9	15.0	15	1.0	15.0	15
KDS005*A1B12A1A	3.2	15.0	15	1.8	15.0	15	1.3	15.0	15	0.9	15.0	15	1.0	15.0	15
KDS007*A2B12A1A	6.4	15.0	15	3.6	15.0	15	2.6	15.0	15	1.8	15.0	15	2.0	15.0	15
KDS009*A2B12A1A	6.4	15.0	15	3.6	15.0	15	2.6	15.0	15	1.8	15.0	15	2.0	15.0	15
KDS011*A2B12A1A	6.4	15.0	15	3.6	15.0	15	2.6	15.0	15	1.8	15.0	15	2.0	15.0	15

\* Each asterisk represents a variable character based upon voltage and vintage ordered. See page 2 for complete nomenclature.

† Sound pressure dBA @ 10 feet.

^ Standard connection sizes are for no circuit split. Header diameters are one size larger than connection sizes.

Variance from standard operating conditions may result in connection sizes which are different from those listed above.

## Performance Data - 850 RPM Fan Motors

THR MBH 1°F TD - R407A

Model Number	Fins Per Inch			
	8	10	12	14
KDS001*C1B12A1A	0.63	0.73	0.81	0.90
KDS002*C1B12A1A	1.05	1.19	1.31	1.41
KDS003*C1B12A1A	1.38	1.57	1.72	1.86
KDS004*C1B12A1A	1.97	2.19	2.35	2.49
KDS006*C2B12A1A	2.97	3.37	3.71	4.00
KDS008*C2B12A1A	4.04	4.50	4.82	5.10
KDS009*C2B12A1A	4.69	5.12	5.39	5.70

THR MBH 1°F TD - R404A &amp; R507

Fins Per Inch			
8	10	12	14
0.68	0.79	0.88	0.97
1.09	1.24	1.36	1.47
1.44	1.63	1.79	1.93
1.97	2.19	2.35	2.49
3.09	3.51	3.86	4.16
4.05	4.51	4.83	5.11
4.53	4.94	5.21	5.50

\* Each asterisk represents a variable character based upon voltage and vintage ordered. See page 2 for complete nomenclature.

For R-22 capacity, multiply R404A unit capacity by 1.02

For R-134a capacity multiply R404A unit capacity by .97

For R-407C capacity, multiply R407A capacity by .98

For R-410A capacity, multiply R404A capacity by 1.08

### Notes:

- R-407A ratings are based on Mean Condensing Temperature which is the average of the Dew Point and Bubble Point temperatures corresponding to the refrigerant temperature at the condenser inlet.

## Specifications - 850 RPM Fan Motors

Model Number	Fans				Maximum Circuit Quantity	Connection (Inches) <sup>^</sup>	Connection Quantity	Net Weight (Lbs.)	Unit kW
	Quantity	Diameter	CFM	dBA <sup>†</sup>					
KDS001*C1B12A1A	1	18	2,470	47.0	5	7/8	2	80	0.11
KDS002*C1B12A1A	1	18	2,110	47.0	10	7/8	2	86	0.11
KDS003*C1B12A1A	1	22	3,290	52.0	12	7/8	2	107	0.20
KDS004*C1B12A1A	1	22	2,880	52.0	18	7/8	2	116	0.20
KDS006*C2B12A1A	2	22	6,390	55.0	18	1-1/8	2	164	0.40
KDS008*C2B12A1A	2	22	5,760	55.0	27	1-1/8	2	179	0.40
KDS009*C2B12A1A	2	22	5,170	55.0	36	1-1/8	2	195	0.40

Model Number	208-230/1/60			208-230/3/60			460/1/60			460/3/60			575/1/60		
	FLA	MCA	MOPD	FLA	MCA	MOPD	FLA	MCA	MOPD	FLA	MCA	MOPD	FLA	MCA	MOPD
KDS001*C1B12A1A	1.4	15.0	15	1.1	15.0	15	0.7	15.0	15	0.6	15.0	15	-	-	-
KDS002*C1B12A1A	1.4	15.0	15	1.1	15.0	15	0.7	15.0	15	0.6	15.0	15	-	-	-
KDS003*C1B12A1A	1.4	15.0	15	1.1	15.0	15	0.7	15.0	15	0.6	15.0	15	-	-	-
KDS004*C1B12A1A	1.4	15.0	15	1.1	15.0	15	0.7	15.0	15	0.6	15.0	15	-	-	-
KDS006*C2B12A1A	2.8	15.0	15	2.2	15.0	15	1.4	15.0	15	1.2	15.0	15	-	-	-
KDS008*C2B12A1A	2.8	15.0	15	2.2	15.0	15	1.4	15.0	15	1.2	15.0	15	-	-	-
KDS009*C2B12A1A	2.8	15.0	15	2.2	15.0	15	1.4	15.0	15	1.2	15.0	15	-	-	-

\* Each asterisk represents a variable character based upon voltage and vintage ordered. See page 2 for complete nomenclature.

† Sound pressure dBA @ 10 feet.

<sup>^</sup> Standard connection sizes are for no circuit split. Header diameters are one size larger than connection sizes.

- Not available in 575V.

Variance from standard operating conditions may result in connection sizes which are different from those listed above.

**Due to continuing product development, specifications are subject to change without notice.**